




### Leeward Subdivision - Architectural Review Committee Typical Dual Driveway Configuration Detail

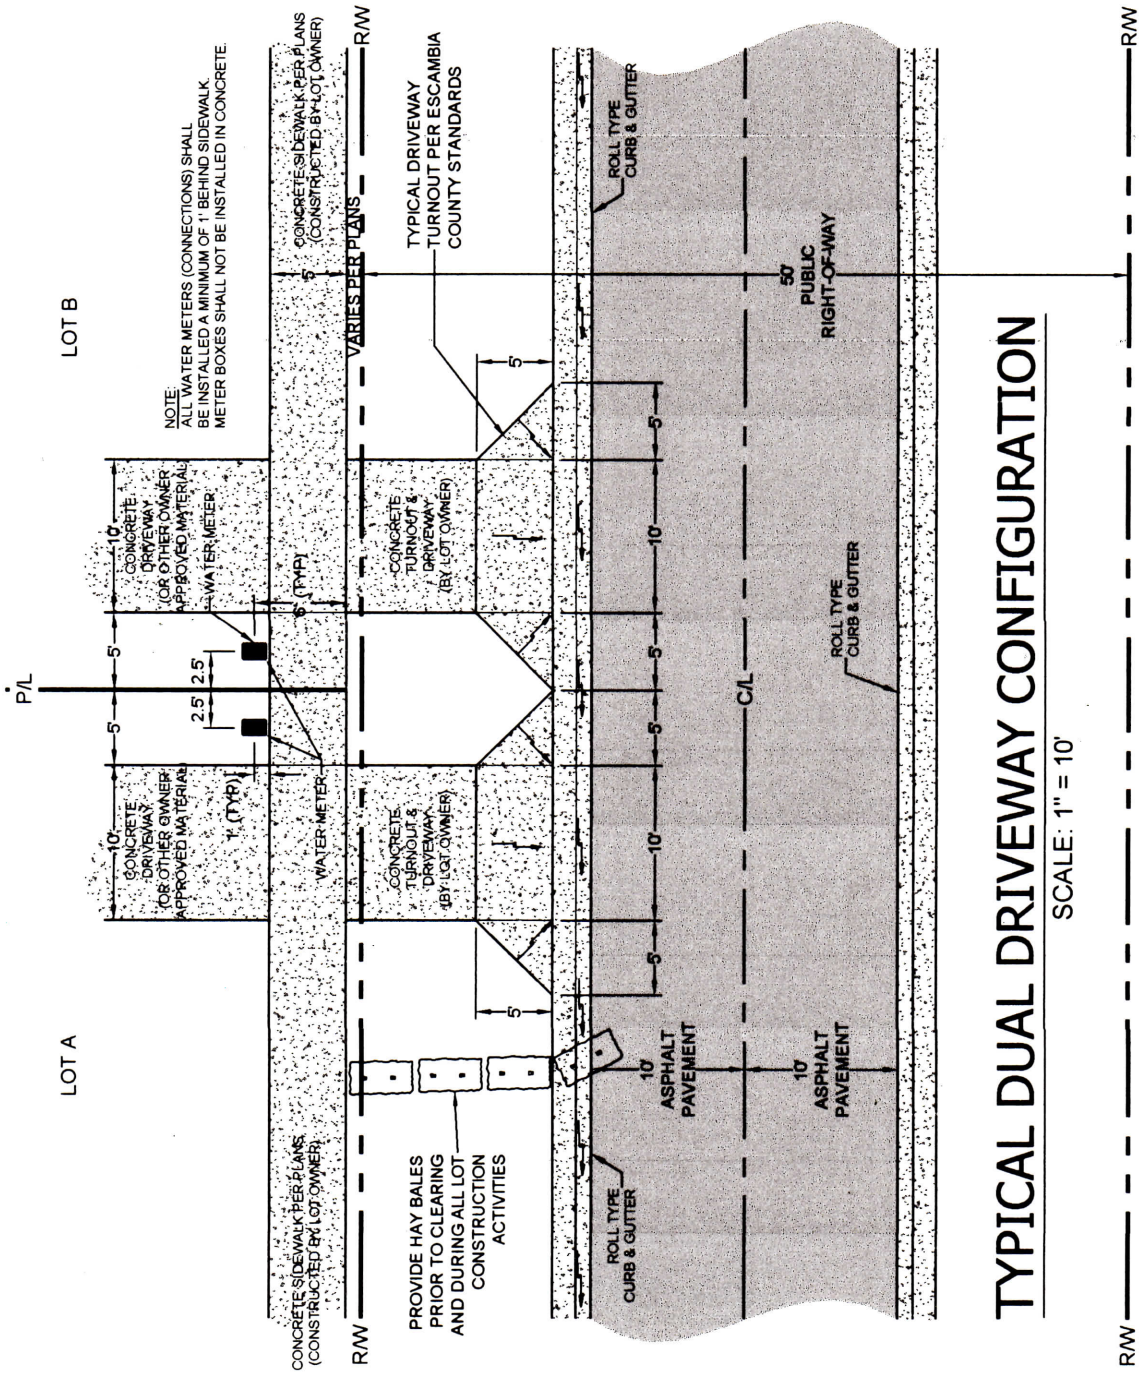

NOTE:  
ALL WATER METERS (CONNECTIONS) SHALL BE INSTALLED A MINIMUM OF 1' BEHIND SIDEWALK. METER BOXES SHALL NOT BE INSTALLED IN CONCRETE.

PROVIDE HAY BALES PRIOR TO CLEARING AND DURING ALL LOT CONSTRUCTION ACTIVITIES